




**NOTICE TO ALL  
BUILDERS AND EXCAVATORS**

Morinville has a third storm service connection for sump pump system discharges in all new developments.

If you are unsure where the storm pipe is located, please contact the Developer to find out the location in order to avoid damaging the storm pipe. NOTE: It is the Developers responsibility to ensure service installations are in accordance with municipal engineering standards and properly marked.

Please find attached drawings of a typical sump pump discharge connection for a house as well as typical service locations.

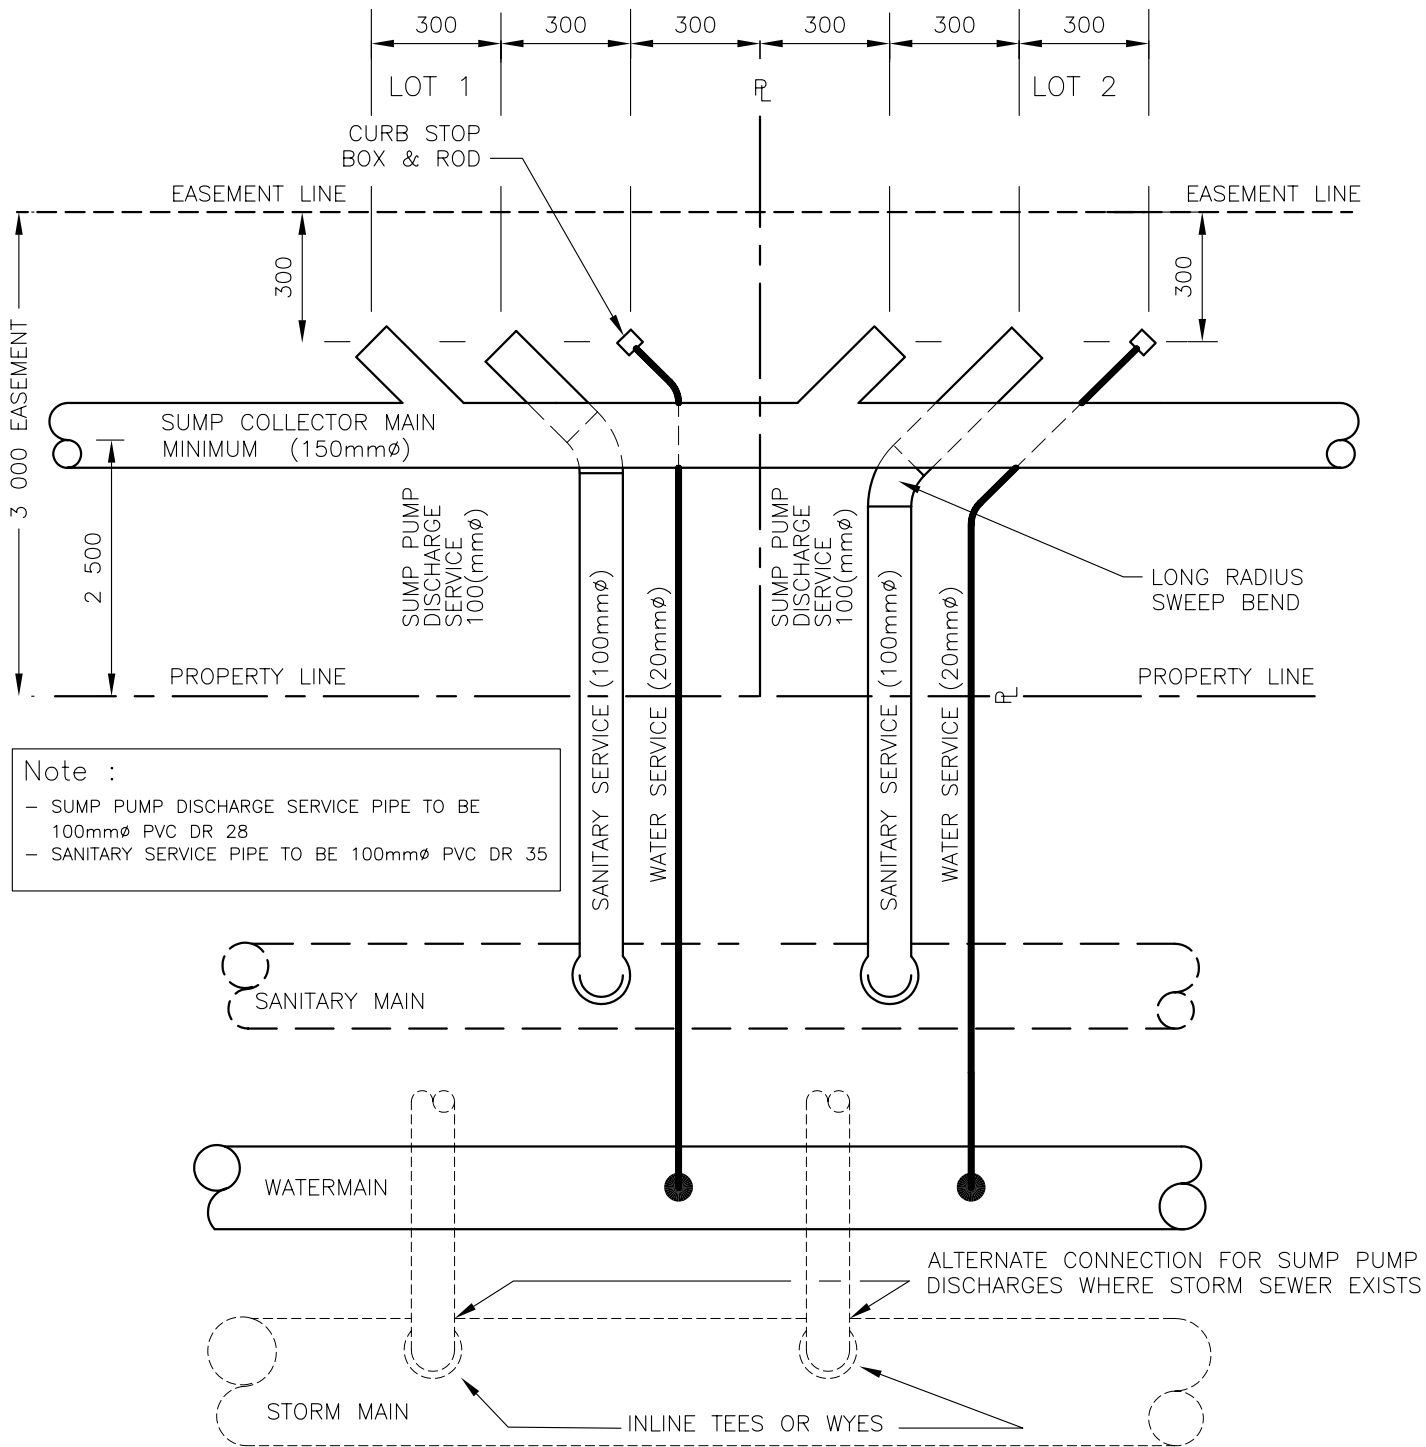

**Note :**

- SUMP PUMP DISCHARGE SERVICE PIPE TO BE 100mm $\phi$  PVC DR 28
- SANITARY SERVICE PIPE TO BE 100mm $\phi$  PVC DR 35

**NOTES:**


1. FOR SERVICES TO LOTS ON THE OPPOSITE SIDE OF THE STREET, THE SAME GENERAL ARRANGEMENT IS REQUIRED.
2. FOR SECTION VIEWS AND ADDITIONAL NOTES, SEE DRAWINGS 6.01, 6.02, 6.03, 6.04, 6.06 & 6.07
3. SUMP PUMPS ARE REQUIRED IN ALL HOUSES. THE REQUIRED SUMP PUMP AND DISCHARGE PIPING ARRANGEMENT IS SHOWN ON DWG NO. 6.04 . THE DIRECT CONNECTION OF WEeping TILE DRAINAGE SYSTEMS TO THE SANITARY MAINS IS NOT PERMITTED.
4. AUGERED INSTALLATION IS REQUIRED UNDER EXISTING STREETS AND SIDEWALKS.
5. ALL DIMENSIONS IN MILLMETRES UNLESS OTHERWISE NOTED.

**DOUBLE SERVICE**




**TOWN OF VILLE DE MORINVILLE**

REVISIONS			
DESIGNED/DRAWN	GRM/WLJC	APPROVED	
SCALE	N.T.S.	DATE	DECEMBER, 2003.
		DRAWING NO.	6.05

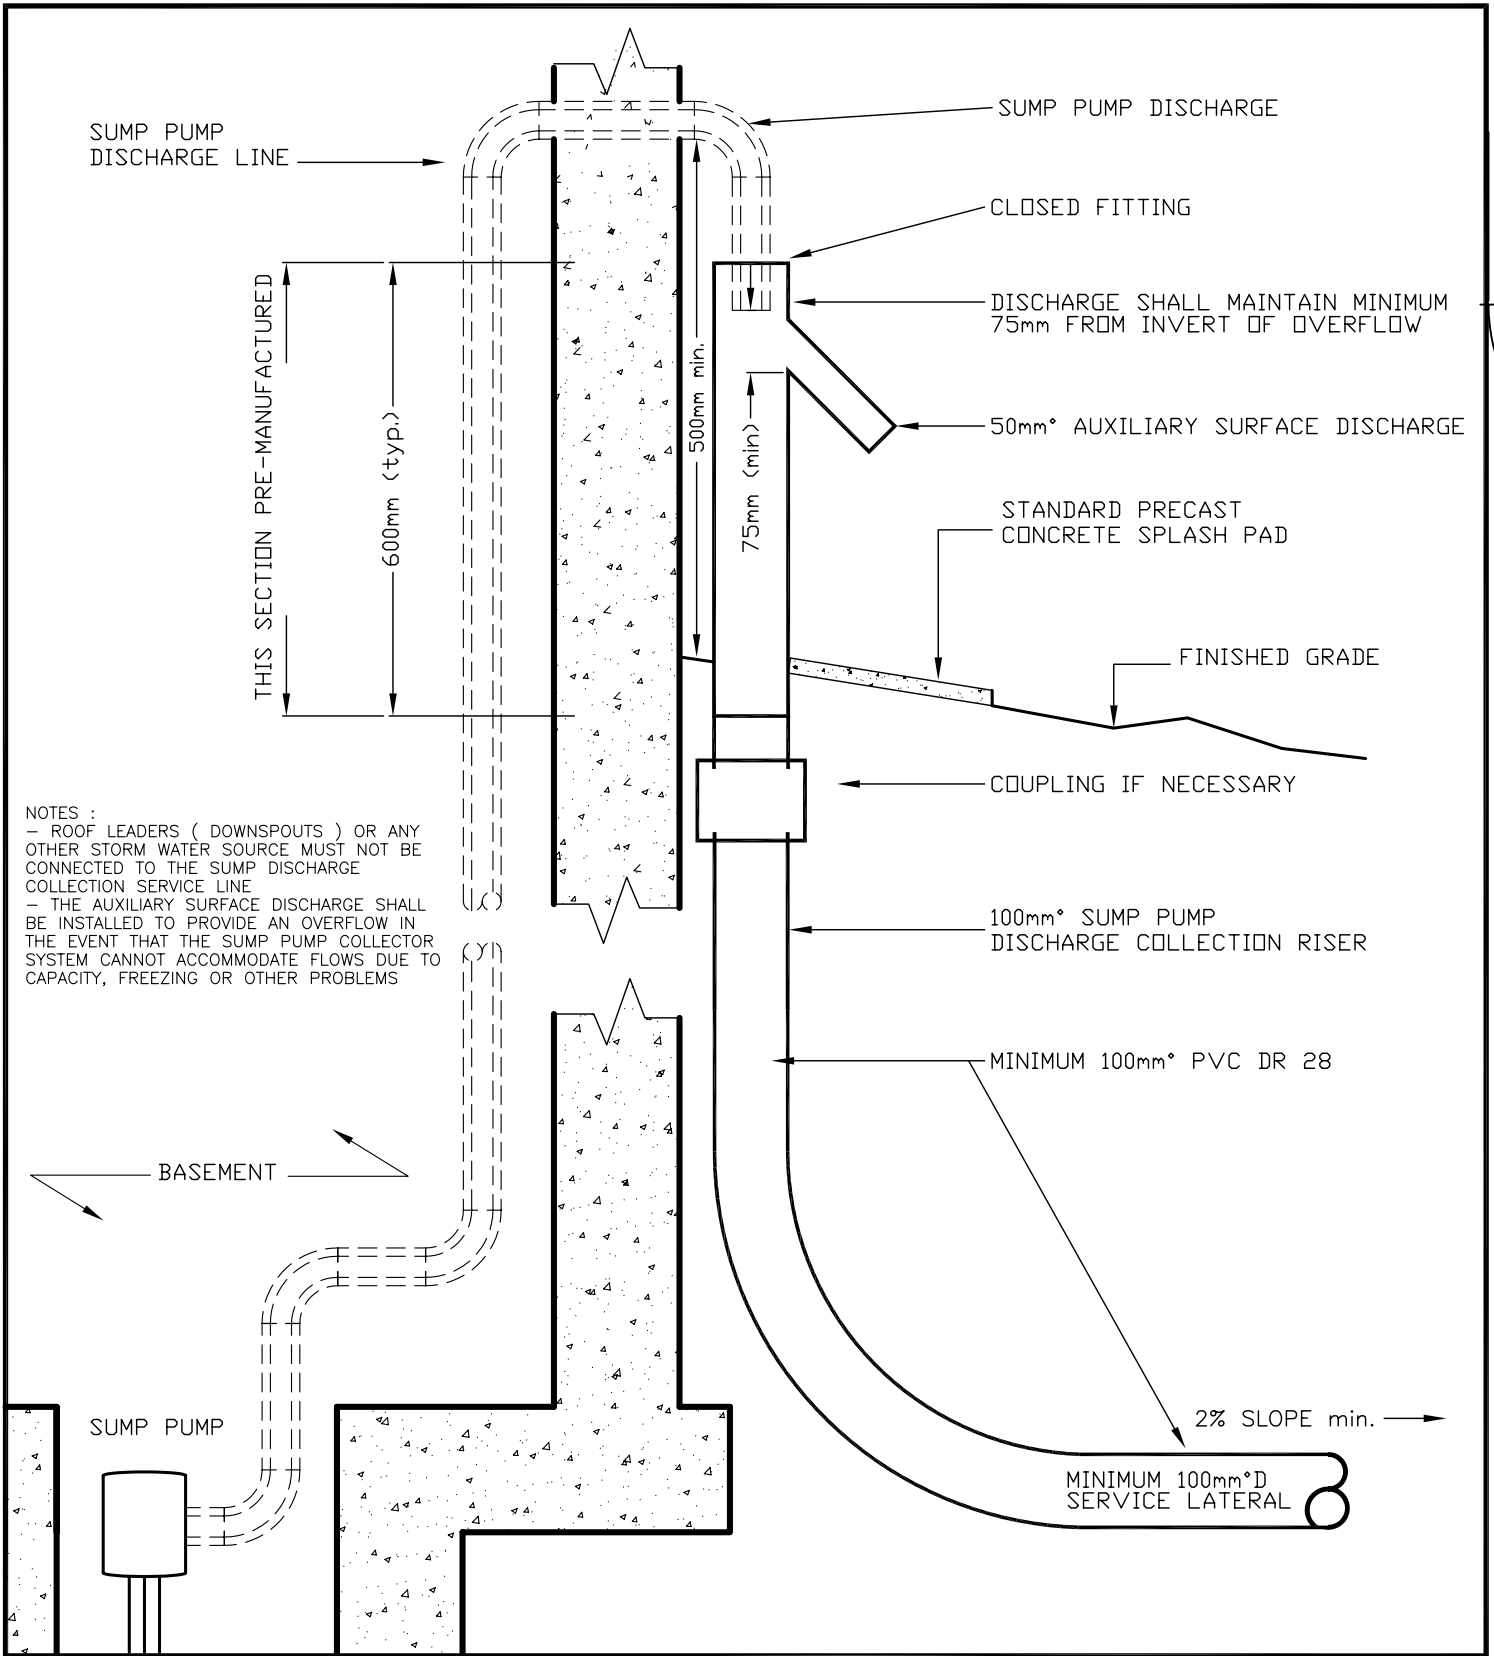

## TYPICAL SUMP PUMP DISCHARGE CONNECTION AT HOUSE

	<b>TOWN OF · VILLE DE MORINVILLE</b>	REVISIONS		
			APPROVED	
	DESIGNED/DRAWN	GRM/WLJC	DATE	DECEMBER, 2003.
	SCALE	N.T.S.	DRAWING NO.	6.04